

No.: SHIN181103438CCM

Date: Nov. 26, 2018

Page: 1 of 4

CUSTOMER NAME: LG HAUSYS CO., LTD.

ADDRESS: 16F, ONE IFC, 10, GOOKJEGEUMYOONG-RO, YOUNGDEUNGPO-GU,

SEOUL

The test results were transferred from Report No. SHIN181003024CCM dated Nov. 16, 2018 issued

by SGS.

Sample Name : DECOLAY

Others : SGS Korea File No.: AYAA18-51102

Above information and sample(s) was/were submitted and confirmed by the client. SGS, however, assumes no responsibility to verify the accuracy, adequacy and completeness of the sample information provided by client.

Test Required : Slip resistance (oil-wet ramp test)

Test Method : DIN 51130:2014-02

Date of Receipt : Oct. 15, 2018

Testing Start Date : Oct. 15, 2018

Testing End Date : Nov. 16, 2018

Test result(s) : For further details, please refer to the following page(s)

(Unless otherwise stated the results shown in this test report refer only to

the sample(s) tested)

Signed for

SGS-CSTC Standards Technical Services (Shanghai) Co., Ltd.

Erin Huang

Authorized signatory





No.: SHIN181103438CCM

Date: Nov. 26, 2018

Page: 2 of 4

Summary of Result(s):

No.	Test Item	Test Method	Result	Conclusion
1	Slip resistance (oil-wet ramp test)	DIN 51130:2014-02	R9	/

Note: Pass : Meet the requirements;

Fail: Does not meet the requirements;

/: Not Apply to the judgment.





No.: SHIN181103438CCM

Date: Nov. 26, 2018

Page: 3 of 4

Test item: Slip resistance (oil-wet ramp test)

Test Method: DIN 51130:2014-02 Testing of floor coverings - Determination of the anti-slip property -

Workrooms and fields of activities with slip danger, walking method - Ramp test

Sample Description: Flooring, cut from 2 pieces of original samples 1200mm×180mm, form a testing

surface of 1000mm×540mm, see photo(s)

Test Result:

Testing surface & testing direction: see the photo(s)

Test item(s)	Test result(s)	Classification
Slip resistance (oil-wet ramp test)	Critical angle of inclination: 9.0°	R9

Classification of oil-wet ramp test:

Classification	Angle (degrees)
R9	6°≤X≤10°
R10	10° <x≤19°< td=""></x≤19°<>
R11	19° <x≤27°< td=""></x≤27°<>
R12	27° <x≤35°< td=""></x≤35°<>
R13	>35°

Note: The test was performed by SGS-CSTC Standards Technical Services Co., Ltd. Xiamen Branch Testing Center.



Unless otherwise agreed in writing, this document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at http://www.sgs.com/en/Terms-and-Conditions.aspx and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at <a href="http://www.sgs.com/en/Terms-and-Conditions/Terms-and-Cond




No.: SHIN181103438CCM

Date: Nov. 26, 2018

Page: 4 of 4

Sample photo(s):

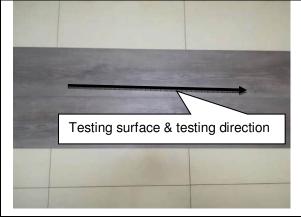

****** End of report*****

